


# MANTUA TOWNSHIP MUNICIPAL UTILITIES AUTHORITY

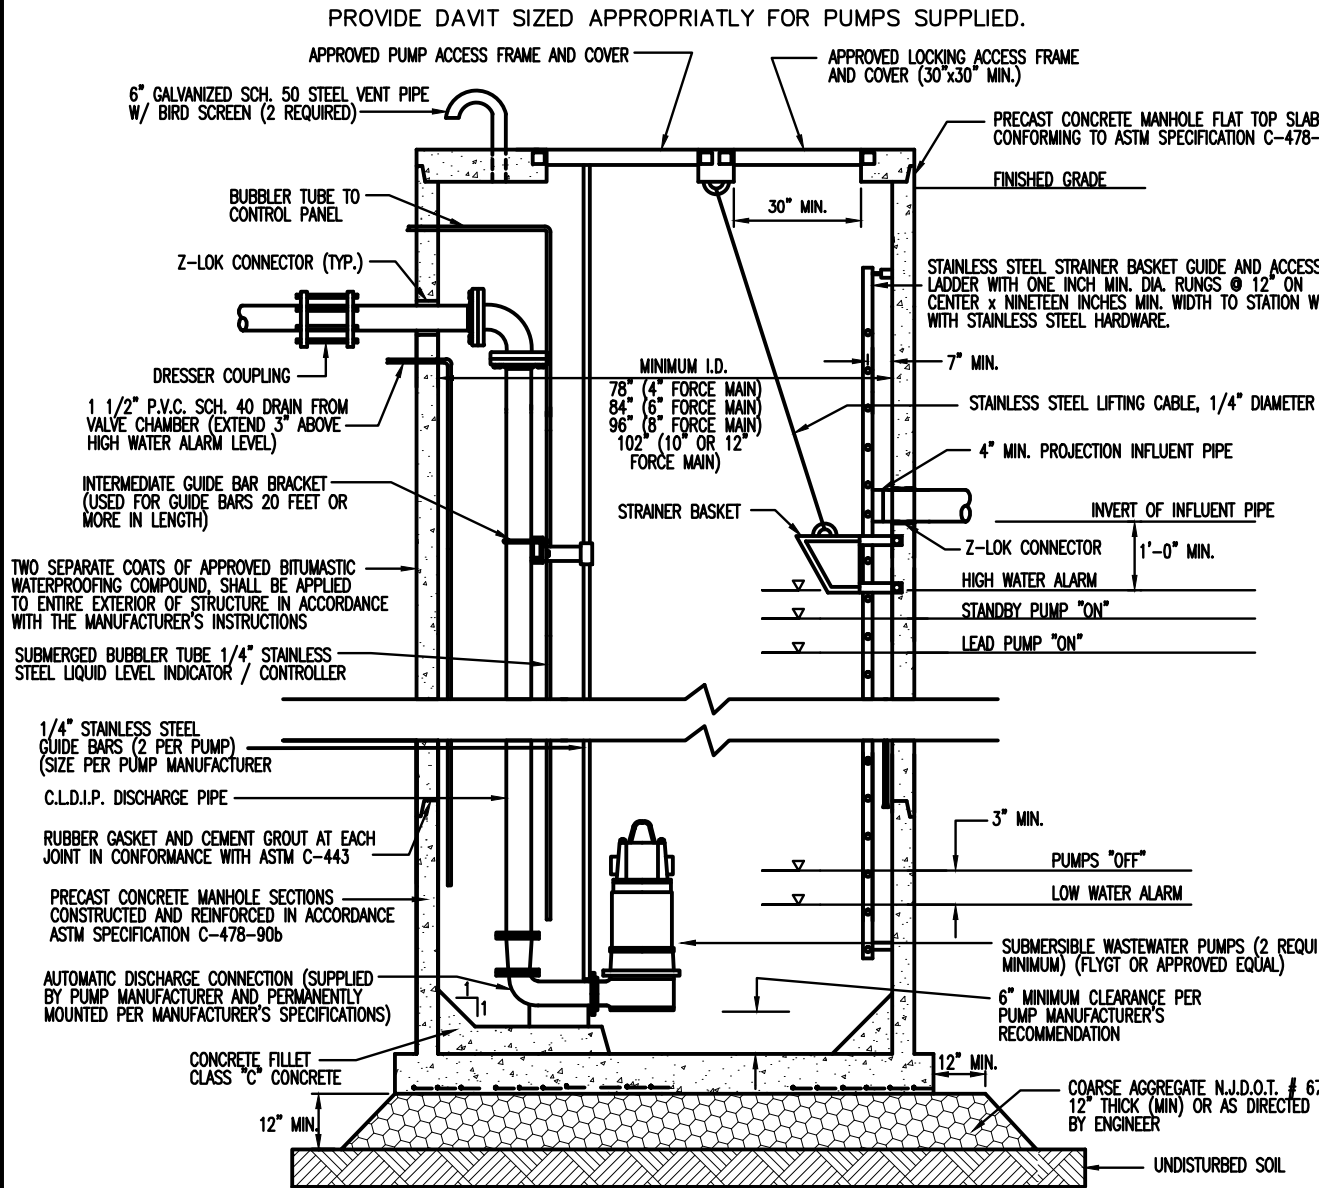

**NOTES:**

1. INFLUENT PIPE, STRAINER BASKET, LIFTING CABLE, AND LADDER ROTATED 90 DEGREES FROM CLARITY. SEE STANDARD PUMP STATION DETAIL AND NOTES, DWG. NO. 26, 27, AND 28.
2. ALL PUMP STATION HARDWARE TO BE STAINLESS STEEL.

## STANDARD PUMP STATION DETAIL

N.T.S.